


NOTES:

1. PVC PIPE SLEEVE IS A LISTED PART OF ENCLOSURE. IN A FIRE, THE PVC PIPE WILL MELT, AND THE INTUMESCENT COLLAR WILL FILL THE OPENING.
2. CONNECT ELECTRICAL WIRING AT ENCLOSURE KNOCKOUTS PER ENCLOSURE MANUFACTURER'S INSTRUCTIONS

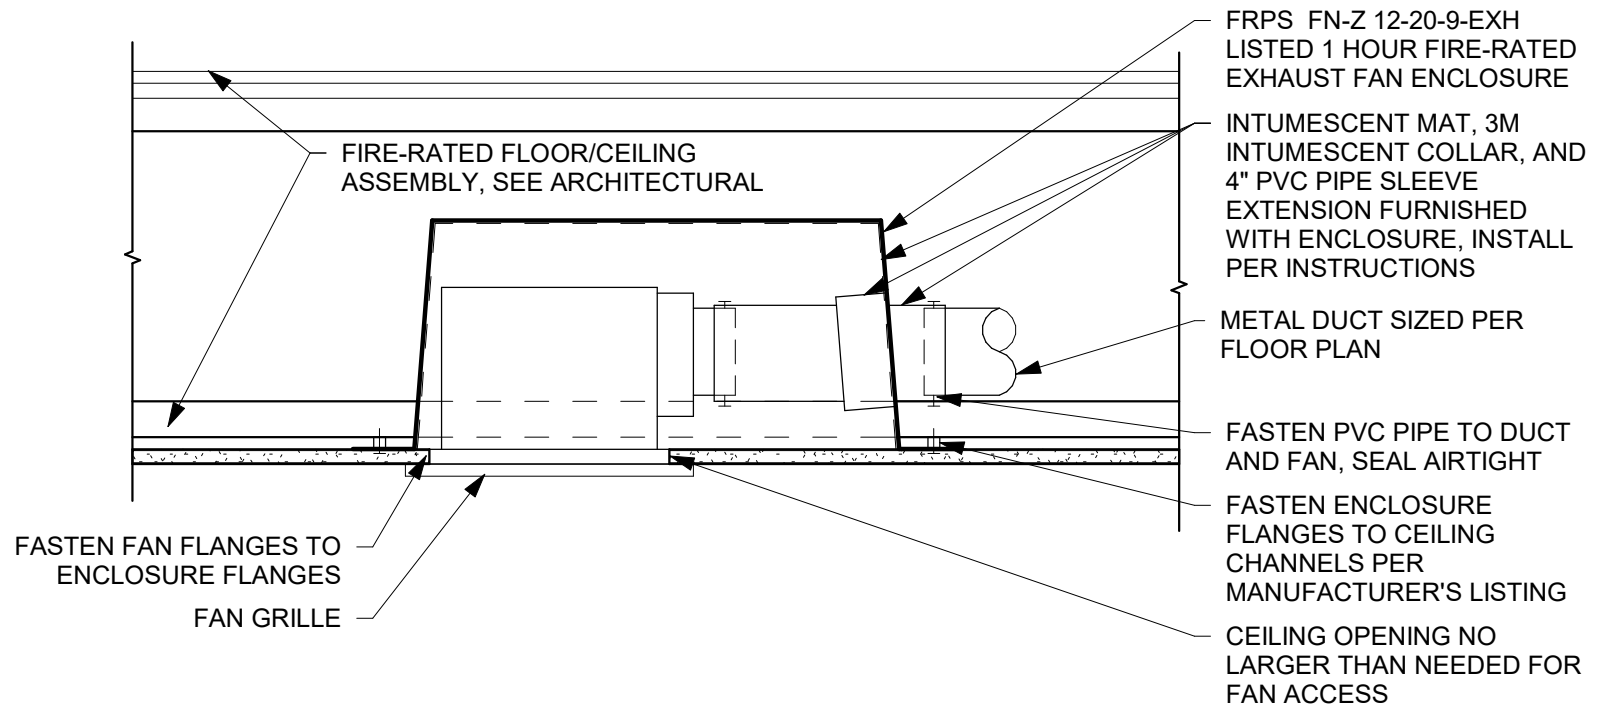

TITLE: 1 HR RATED BATH FAN ENCLOSURE

DRAWING NO. FN-Z 12-20-9 EXH

SCALE: 1 1/2" = 1'-0"

FRPS