


NOTES:

1. PROVIDE FIRE-RATED PENETRATION PROTECTION SYSTEMS AT ALL RECESSED DEVICES LOCATED IN FIRE-RESISTANCE-RATED ASSEMBLIES.
2. COORDINATE WITH APPLICABLE LISTED ASSEMBLY DESIGN.
3. INSTALLATION SHALL COMPLY WITH MANUFACTURER INSTRUCTIONS AND PROJECT SPECIFICATIONS.
4. FIRESTOPPING OF MEMBRANE -PENETRATIONS SHALL BE PROVIDED UNDER IBC CHAPTER 7 SECTION 7.
5. DO NOT INSTALL RECESSED DEVICES IN RATED ASSEMBLIES WITHOUT REQUIRED PROTECTION SYSTEMS.

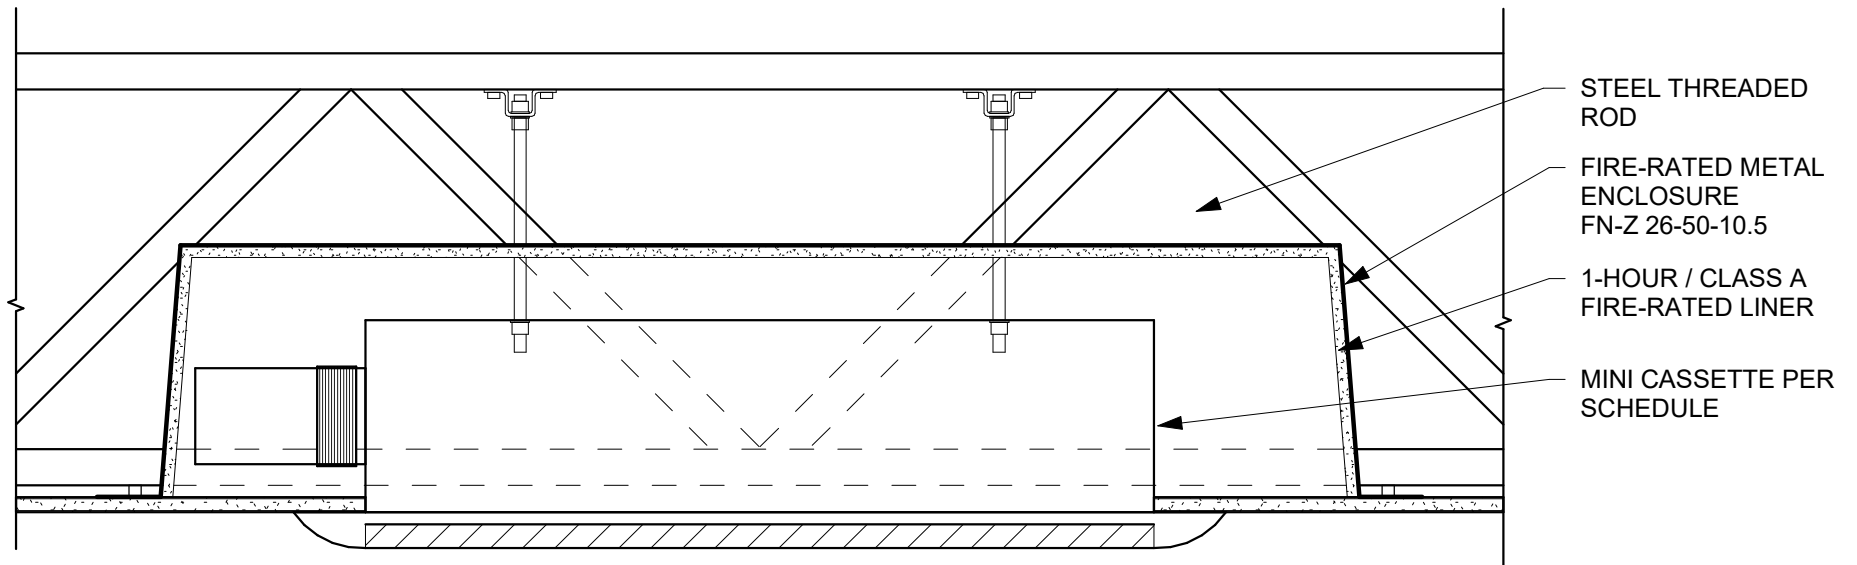

TITLE: FIRE RATED METAL ENCLOSURE

DRAWING NO. **FN-Z 26-50-10.5**

SCALE: 1 1/2" = 1'-0"

FRPS